



Division 08 Openings

08 05 00 Common Work Results for Openings

08 05 10 General Requirements for Openings

1. Fenestration for all UW Madison facilities shall comply with all the provisions of the latest version of the Division of Facilities Development (DFD) *Design Requirements and Guidelines for Fenestration in Building Exterior Enclosures*, which is available from the DFD website.
2. References within the DFD Guidelines regarding the DFD Project Manager shall apply to the UW-Madison Project Manager on UW-Madison Managed Projects.
3. Project Specifications shall use as their basis all appropriate sections of the latest edition of the DFD Master Specifications.
4. Deviations from DFD's Minimum Design Guidelines or the DFD Master Specification sections shall be made only upon approval from the UW-Madison Project Manager.
5. The *Guidelines for Planning and Design of UW-Madison Facilities* shall take precedence over DFD Guidelines, but the A/E shall discuss all conflicts within the guidelines and specifications with the UW-Madison Project Manager.

08 10 00 Doors and Frames

08 11 00 Metal Doors and Frames

1. Contractors shall remove all rating labels from doors/frames that are not installed in rated wall assemblies. If the wall is not rated, the door/frame shall appear as non-rated.
2. When applicable, exterior, and interior pairs of doors shall have a removable mullion.
3. All metal frames and doors shall be reinforced for door closers.
4. All interior metal frames shall have face trim 2" in width except where matching existing.
5. All metal frames shall be 16 GA in thickness. Exception: 3-sided frames > 48" to be 14 GA minimum. Exterior metal frames shall be 14 GA galvanized.

08 14 00 Wood Doors

1. Wood doors shall be of standard manufactured size. Either 3'-0" x 6'-8" or 3'-0" x 7'-0". Doors 3'-0" x 6'-8" are recommended only when matching existing for a remodel or addition. Exceptions may occur based on design considerations.
2. Wood doors shall be of a common species, with matched cut, throughout the project.
3. All wood doors shall have 3/4" solid, species-matched wood edges the full length of the door.



4. Wood doors shall not be installed within the vicinity of loading docks where heavy cart action or pallet jack usage occurs.
5. When installing pairs of wood doors, all wood door corners using corner mount flush bolt(s) shall be equipped with sleeve reinforcement (flush bolt end caps).

08 30 00 Specialty Doors and Frames

08 31 00 Access Doors and Panels

1. The campus standard for access control is the Lenel Onguard.
2. Refer to *Division 28 11 05 Electronic Access Control for New Construction* and *Division 08 71 13 Automatic Door Openers* for the typical location of proximity card readers for added convenience and security.
3. Prior to 35% review documents, there shall be a coordination meeting with the A/E, and UW-Madison Police Department (UWPD) and EH&S. The contractor shall design and the UWPD provide the primary components for the access control system.
4. The contractor shall pull all the cables/wires to the IDF.
5. The UWPD purchase all Access Control components including enclosures and panels at the cost of the project. The contractor is responsible for installing the closures in the electric closets and the UWPD or designee will install panels and terminate the system.
6. The contractor shall purchase and install all the card readers and/or rough-ins for future card readers.

08 32 00 Sliding Glass Doors

Sliding glass doors shall be supported on top and have a bottom guide(s) to help secure the door in the locked position.

08 33 00 Coiling Doors

An airlock should be provided between the loading dock (where an overhead coiling door is used) and the main building.

08 36 00 Sectional Doors

An airlock should be provided between the loading dock (where an overhead sectional door is used) and the main building.

08 70 00 Hardware

08 71 00 Door Hardware

Prior to the start of hardware installation, the contractor shall schedule and conduct pre-installation meeting with the hardware supplier, and the lock, exit device, and door closer manufacturers' representative(s). The installer and related trades shall coordinate materials and techniques, and sequence complex hardware items and systems installation. Proper and correct installation and adjustment of hardware shall be reviewed, and criteria for punch list review shall be established. A coordination meeting shall occur at least one week prior to the commencement of hardware installation. Written documentation of the date and attendees/participants shall be provided to the architect and the UW-Madison Project Manager.



08 71 01 Locks

1. All mortise locksets shall be able to be re-handed in the field without removing the cover.
2. All locksets shall be provided with a lever handle and mounted at the appropriate height per ADA standards.
3. Escutcheon trim is strongly preferred for flexibility of future hardware changes. Sectional trim is acceptable when approved by the UW-Madison Project Manager.
4. Standard finishes for the campus include US26D (626) and US10 (612). Stainless steel finish US32D (630) shall be specified for high moisture or caustic areas.
5. All lock cylinders and keying shall be provided by the UW-Madison Lockshop along with the cost of re-keying. The installation of the lock cylinders shall be the responsibility of the general contractor.
6. Latch guards or astragals on all appropriate exterior doors shall be provided. This creates additional safety against doors being pried open.
7. Specifications state that the General Contractor shall be responsible for signing out keys and shall be financially responsible if keys are not returned.
8. Electric strikes are not allowed.
9. Where deadbolts must be used, specify a mortise version with appropriate pull(s).

08 71 02 Hinges

1. Continuous hinges shall be used on exterior doors.
2. Non-removable hinge pins shall be used on lockable out-swinging doors.
3. Aluminum doors shall have continuous hinges.
4. Heavy duty ball bearing or continuous hinges shall be used on openings with high traffic.
5. Standard ball bearing hinges shall be used on interior and moderately used openings.

08 71 04 Fire Door Hold Open Devices

Hold-open devices shall be 12 or 24 volt, hard wired.

08 71 13 Automatic Door Operators

1. Operators shall be electro-mechanical hard wired (not wireless). For certain applications where hard wired is not feasible (for example, glass doors), then wireless shall be acceptable. Each wireless push plate shall have separate input through a radio receiver. The campus standards are Stanley Magic Force (exterior), Stanley Magic Access (interior), and LCN Senior Swing.



2. Push plates shall be located per standard accessibility details in the Division 8 Appendix. Push plates shall not be placed on a mullion without approval from the UW-Madison Project Manager. Bollard mounted push plates need to be approved by UW-Madison Facilities Planning and Management. The operator shall be fitted with a lockout device that allows exterior push plate/radio controls to be turned off, leaving the interior switch mechanism operable. The operator shall be compatible with electronic security devices.
3. Automatic Door Opener Locations: For all new buildings, the accessible main entrance on each grade level shall have at least one door with an automatic door opener. Actuators shall be 48" from any perpendicular obstruction or door frame to allow sufficient clear floor space to open the door and installed per ADA standards.
4. A sign that identifies automatic doors shall include the international accessibility symbol. Standard adhesive backed signs shall be installed on the power assist door surface at 53 inches on center A.F.F., 5 inches from door hinge side. (Note: this placement might be door specific and should be verified by UW-Madison FP&M). See accessibility details in Division 08 Appendix.
5. For existing buildings, the push plate for the door opener shall be installed in accordance with ADA guidelines.
6. Push plates, proximity card readers, and bollard locations: If a proximity card reader is needed, along with a push plate, the reader shall be 32 inches on center A.F.F., alternate height with permission from UW-Madison project manager. The push plate shall be in close proximity and follow the reader in a sequence to allow the user to swipe their card before approaching the push plate; for accessibility. If the site has a bollard with both a push button and a proximity card reader, the mounting height shall be 32 inches on center A.F.F. less Collar (LC), alternate height with permission from UW-Madison project manager.

08 71 20 Institutional Door Hardware Standards

1. All lock cylinders and keying shall be provided by the UW-Madison locksmith shop along with the cost of keying.
2. Interchangeable Construction Cores: For all key-locked doors in new construction, the contractor shall provide the lock cylinder with a full-size interchangeable construction core. These cores are temporary for the construction period with the contractor in control of keying. These temporary construction cores are for securing the facility, elevator equipment rooms, IT rooms, high voltage rooms, and other spaces as required. At the end of construction, the temporary cores are replaced with the permanent cores. The core replacement shall be the responsibility of the contractor. Temporary construction cylinders/cores shall remain supplier's property. Supplier shall furnish construction keys and construction control keys as needed to UW-Madison Lock Shop, All interchangeable cores shall be furnished as follows:
 - 2.1. Zero bitted key blanks less collar.
 - 2.2. The cores shall be keyed by the UW-Madison Lock Shop
 - 2.3. All permanent cores to be purchased by UW-Madison.
 - 2.4. All permanent cores shall be installed by the contractor.
 - 2.5. Construction keying: Furnish temporary keyed alike cylinders/cores.
3. Exit Devices: All Exit Devices shall be Sargent 80 series or Von Duprin 99 series.
4. Removable Mullion: Shall match exit device manufacturer. Keyed mullions are preferred.



5. Door Closers: All closers shall be LCN 4040XP or Sargent 281 with plastic covers.
6. Power Operators: All power operators shall be Stanley Magic Force (exterior), Stanley Magic Access (interior), or LCN Senior Swing.
7. Hardware Installation: A pre-installation meeting which includes the Manufacturer's representatives, DFD construction rep and the UW-Madison Lock Shop shall be coordinated by the contractor.
8. All electric power transfers shall be EPT, not thru-wire hinges. EPT must have a minimum of ten 24AWG wires with max. rating of 24V dc, 1 amp.
9. At multi-stall restrooms, closers shall have hold open ability. Single use toilet rooms shall have occupancy indicators on privacy locks.



Door Hardware – Approved Manufacturers (in alphabetical order):

<u>Description</u>	<u>Manufacturer</u>	<u>Model/Series</u>
Hanging Device:		
Butt Hinges	Ives	5BB1, 5BB1HW (stainless steel at wet/corrosive areas) 3CB1, 3SP1
	McKinney	TA2714, T4A3786 (TA2314, T4A3386 at wet/corrosive) TA314, 1502
Continuous Hinges	Ives	112HD, 224HD EPT option (power transfer prep)
	Pemko	FM-SLF-HD1, FMHD1 PT option (power transfer prep)
	Markar	FM300, FS-302, HG305
Pin & Barrel	Ives	700, 702, 705
Securing Devices:		
Cylinders by GC		Furnished and keyed by UW-Madison Locksmith, installed
Mortise Lock *	Sargent	8200 Series
	Schlage	L9000 Series *Escutcheon trim preferred, owner to determine lever style/design.
Cylindrical Lock	Sargent	10 Line
	Schlage	ND Series
Exit Device	Sargent	80 Series 19- prefix = less Lexan touch pad 59- prefix = delayed egress (use with caution) 56- prefix = electric latch retraction 53- prefix = latchbolt monitoring 55- prefix = request to exit in push bar
	Von Duprin	99 Series -CX = delayed egress (use with caution) -QEL = electric latch retraction -LX = latchbolt monitoring -RX = request to exit in push bar
Removable Mullion	Sargent or Von Duprin	Match manufacturer of exit devices
Electric Strike * *use with caution	HES	1500/1600 (locksets) 9400/9500/9600 (rim exits)
	Von Duprin	6210/6211 (locksets) 6300/6400 (rim exits)
Flush Bolts	Ives	FB358/458 (manual) FB31P (automatic)



		FB41P (constant latching) DP1 (dustproof strike)
	Rockwood	555/557 (manual) 2842 (automatic) 2942 (constant latching) 570 (dustproof strike)
Magnetic Locks (use with extreme caution)	Schlage or Securitron	Approved only as required
Closing Devices:		
Mechanical Door Closers	LCN	4040XP Series, EDA arms, CUSH/SCUSH for push side
	Sargent	281 Series, PD arms, PS/CPS for push side
Low Energy Operator	LCN	Senior Swing 9500 Series
	Stanley	Magic Force – Exterior Magic Access – Interior
Stops and Holders:		
Overhead Stops and Holders	Glynn-Johnson, Hager, or Rixson	*Stop arm closers preferred. Overhead stops to be used only where necessary.
Wall and Floor Stops	Hager, Ives, or Rockwood	
Other Hardware:		
Coordinator	Ives	COR x FL
	Rockwood	2600 Series
Push/Pull Plate	Ives	8200, 8303
	Rockwood	70C, 111 x 70B
Kick/Armor Plate	Ives	8400
	Rockwood	K1050
Power Transfer Device	Securitron	EL-CEPT
	Von Duprin	EPT-10
Power Supply* *coordinate with GC & Electrical Contractor	Securitron	BPS Series
	Von Duprin	914 with appropriate card
Magnetic Door Holder	LCN	SEM Series
	Rixson	990 Series
Threshold, Weather-Strip, Sweeps, etc.	National Guard, Pemko, or Reese	*No vinyl seals allowed.
Access Control System	Lenel	



08 71 30 Door Hardware Installation

To ensure proper installation and adjustment of hardware items, the architect shall include the following verbiage within the Finish Hardware Section of the project specifications:

Prior to the start of hardware installation, the contractor shall schedule and conduct a pre-installation meeting with the hardware supplier, lock, exit device, and door closer manufacturers' representative(s), installer, owner's representative, and related trades, to coordinate materials and techniques and to sequence complex hardware items and system installation. Proper and correct installation and adjustment of hardware shall be reviewed and the criteria for the punch list review shall be established. All parties shall convene at least one week prior to commencement of hardware installation. Written documentation of the date and attendees/participants shall be provided to the architect and owner for record.

08 71 40 Parking Structure Locking Requirements

1. All doors and locks shall meet the criteria set up by UW-Madison Transportation Services before final completion of the ramp. UW-Madison Transportation Services can supply contractor with a spare key for them to make appropriate locks.
2. All stairwell doors shall have a blank cylinder so they cannot be locked.
3. All snow chutes shall have a master lock padlock with key #2027.
4. Padlocks shall not be used to secure gate.
5. All restrooms and storerooms shall be keyed with a Schlage A7S key.
6. All electrical rooms shall be keyed with a Schlage Primus AAA57 key.
7. Gate equipment shall have an APD 1 key.

08 80 00 Glazing

1. Clear, low-e, insulated window units shall be preferred by the University. The context of specific project shall be taken into consideration with the final selection of glass types.
2. Mock-ups for all exterior building materials, including all window, glazing, and spandrel types shall be required.
3. If glazing or door lights are provided for secured areas (along public hallways) laminated glass shall be used. Pattern glass can be used when necessary for privacy.
4. Door lights shall be acceptable in public and shared spaces such as conference rooms, lounges, etc.
5. Where operable windows are allowed, hoppers, awning or casement windows shall be preferred. A connection between these windows and the air handling system shall be provided for greater energy efficiency.
6. Windows adjacent to green roofs shall have low glare glass to prevent intense sun light from reflecting off the windows and killing the green roof plant material.
7. Any glazing needing replacement, shall be replaced in kind and associated details shall match existing. Exceptions may occur based on design considerations.



Division 08 Appendix - Details

See following attachment



Division 8 Details

Refer to Section 08 71 13 Automatic Door Openers, Item 2.

NOTE:
 STICKER SHALL BE PLACED ON EACH SIDE OF THE DOOR BEING OPENED, AT THE SPECIFIED HEIGHT. EXACT STICKER PLACEMENT LOCATION MIGHT BE DOOR SPECIFIC. CHECK WITH DESIGNER TO VERIFY.

DOOR ID PLACEMENT STICKER

NOT TO SCALE

SITE CONDITIONS MAY NOT ALLOW PUSH BUTTON OPERATOR TO BE INSTALLED ON WALL NEXT TO DOOR. BOLLARD POST MAY BE USED INSTEAD.


PUSH BUTTON LOCATIONS

NOT TO SCALE (NON-BOLLARD APPLICATIONS)

LOCATION OF PUSH BUTTON AND/OR ACCESS CARD READER TO BE MOUNTED 32" A.F.F.

NOTE: ILLUSTRATION ONLY, SITE CONDITIONS MAY VARY. SEE PROJECT LEADER FOR FINAL QUESTIONS.


 WISCONSIN <small>MADISON</small>	Project: Accessibility Details	Designed By: N/A	Date: 01/04/10	
	Drawing Title: ID Sticker and Button Locations	Drawn By: R.JR	Scale: NTS	
	Building No.: N/A	O.S.M.:	Revision:	Date:
	File: L:\ACAD\PLANNING\Accessibility\Accessibility Details\Stickers_PushButtons_Bollards.dwg			
	FACILITIES PLANNING AND MANAGEMENT Campus Planning & Landscape Architecture	Scale: 1/32" WARP 610 Walnut Street Madison, Wisconsin 53726		Sheet: L-1 Of: 2

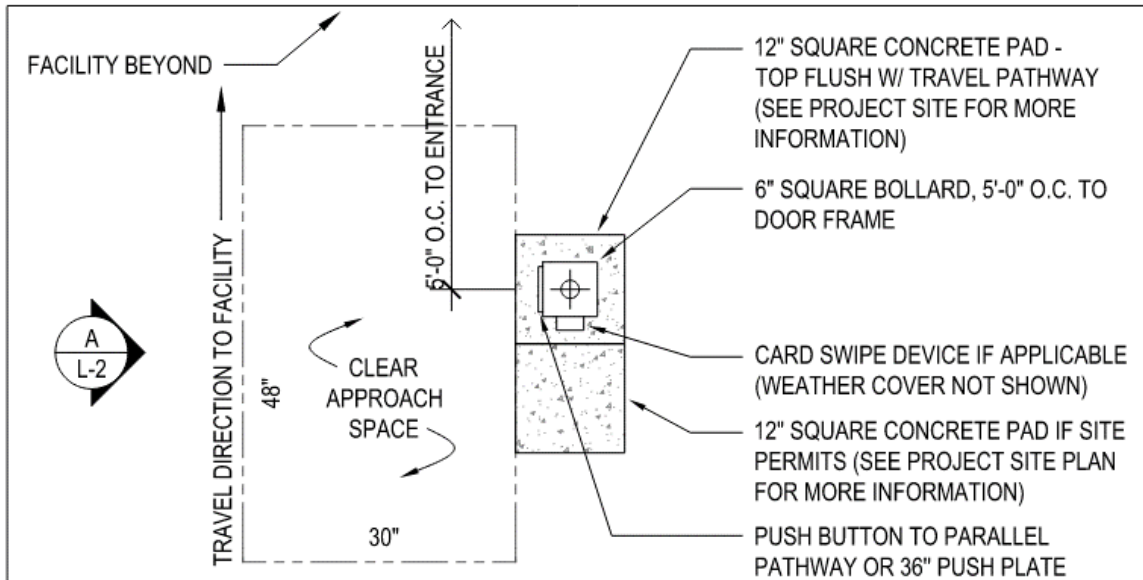

BOLLARD PLAN

NOT TO SCALE

NOTE:
 IF APPLICABLE, THE PUSH BUTTON MOUNTING HEIGHT SHALL BE RAISED TO 38" O.C. INSTEAD OF THE STANDARD 32" O.C. TO ACCOMMODATE A PROX. CARD READER 32" O.C. ON THE SAME SIDE OF THE BOLLARD.

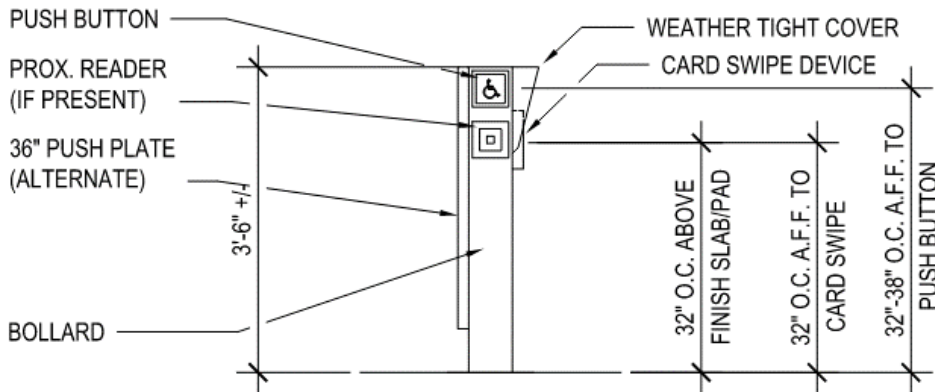

BUTTON MOUNTING HEIGHTS
 NOT TO SCALE

	Project: Accessibility Details	Designed By: N/A	Date: 01/04/10
		Drawn By: RJR	Scale: NTS
	Drawing Title: Bollards and Push Buttons	O.S.M.:	
	Building No.: N/A	Revision:	Date:
File: L:\ACAD\PLANNING\Accessibility\Accessibility Details\Stickers_PushButtons_Bollards.dwg			Sheet: L-2
FACILITIES PLANNING AND MANAGEMENT Campus Planning & Landscape Architecture	Suite 930 WARR 810 Walnut Street Madison, Wisconsin 53726		Of: 2